




GROUND SAFETY RECOMMENDATION

Refueling A/C M – WEST APRON


FIRE SAFETY PERIMETER

6 meters from the tanks. Permitted access for refueling, assistance and control operations.

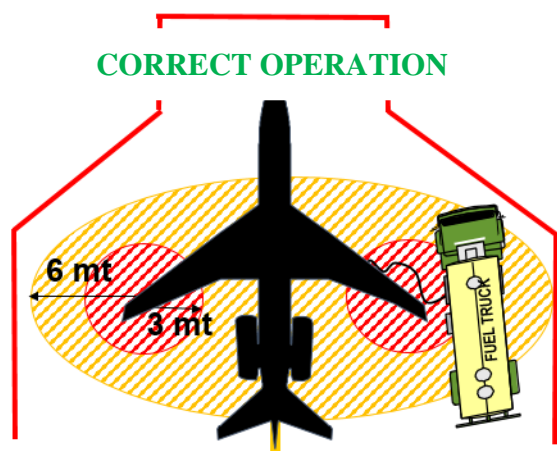

VENTING AREA

3 meters from tanks vents.
Access allowed to refueling operator and equipment strictly necessary.

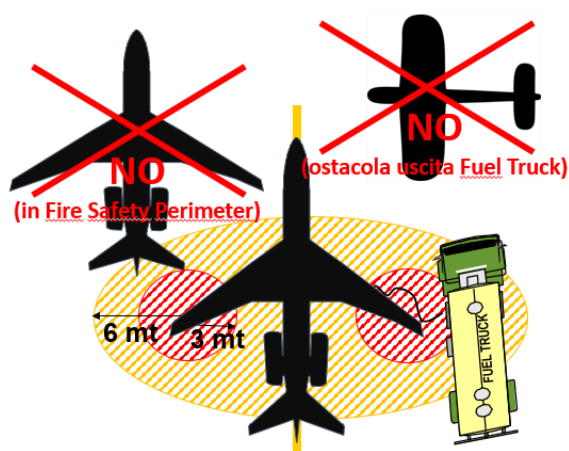

IMPORTANT:

- ✓ Refueling must be carried out in compliance with the "Fire safety perimeter" and the Venting area
- ✓ Service vehicles, assistance vehicles and equipment must be arranged in such a way as to allow rapid removal of the means of supply and do not prevent access to the VVFF vehicles.
- ✓ If the COP or the Responsible / Delegate / Supply Operator believe that there are no security spaces, on the unquestionable provisions of the COP the refueling will be done in the appropriate area. (STANDS from 51 to 56)

REMEMBER:

- The refueling request must be sent to the COP by the Ground Handler or Refueling Handler assisting the CNA by telephone to the Single Number H24 (+39 027485 4801)
 - The refueling Handler, once arrived alongside, will inform the COP of the start of refueling operations by means of radio frequency communication or, alternatively, by telephone call
- If the Safety conditions are not guaranteed, the Refueling Handler has the right to refuse the service.

Be safe at all times!

Make sure that this Ground Safety Recommendation is prominently displayed at your workplace (Safety Corner)